


# **INSTRUCTIONS FOR LED EMERGENCY LIGHTING FIXTURE**

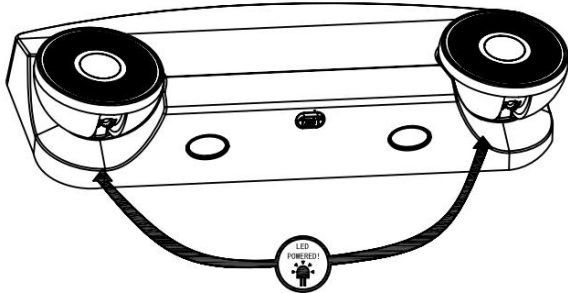

## **IMPORTANT:**

Small Battery in this unit may not be full charged. After electricity is connected to unit. Let battery charge up for at least 24 hours. Then normal operation of this unit should take effect. To check, press the "TEST" button. The light inside the unit should turn on. The lamps listed herein, when used according to these instructions with this unit equipment, are in accordance with the requirements of csa standard C22.2 NO.141. Install wiring to remote heads in accordance with section 46 of the canadian electrical code, part I.


## **IMPORTANT SAFEGUARDS**

When using electrical equipment, basic safety precautions should always be followed including the following:

## **READ AND FOLLOW ALL SAFETY INSTRUCTIONS**

1. Do not use outdoors.
2. Equipment should be mounted in locations at heights where it will not be subject to tampering by unauthorized personnel.
3. Do not mount near gas or electric heaters.
4. The use of accessory equipment is not recommended by the manufacturer may cause an unsafe condition.
5. Do not use this equipment for other than its intended use.
6. Servicing of this equipment should be performed by qualified personnel.
7. Disconnect AC power before servicing.

## **SAVE THESE INSTRUCTIONS**

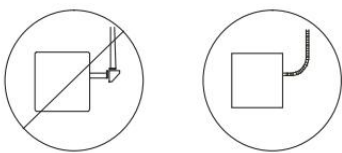

**FLEXIBLE CONDUIT ONLY**

## **INSTALLATION (J-BOX MOUNT)**

1. Feed fixture leads through main bottom case and connect AC power supply (Fig A).
2. Connect wires through J-Box. Main bottom case on J-Box and secure with screws.
3. Connect battery only after continuous AC power can be provided to the unit (Fig. B).
4. Align snaps and push housing directly onto main bottom case (Fig. C). Apply continuous AC power and press TEST button to check light.

## **INSTALLATION (CONDUIT)**

1. Secure main bottom case to wall surface. Route wires through hole in conduit flange and make conduit connection.
2. Connect battery only after continuous AC power can be provided to the unit (Fig. B).

## **INSTRUCTIONS FOR LED EMERGENCY LIGHTING FIXTURE**

3.Align snaps and push housing directly onto main bottom case (Fig. C). Apply continuous AC power and press “TEST” button to check light.

(NOTE:To appear outside blue sleeve of terminal before connecting.)

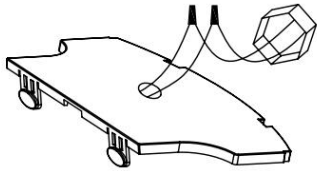


Fig.A(J-BOX)

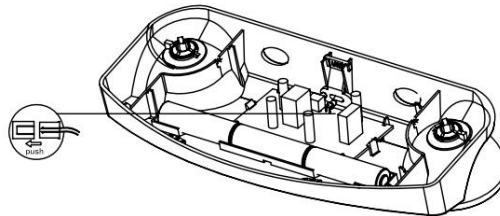


Fig.B

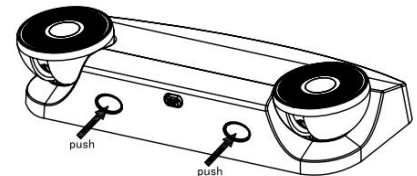


Fig.C

### **WARNING:**

Unused wires must be capped using enclosed wire nuts.

### **OPERATION**

1. During an electrical power failure, the lamps will automatically come on for a minimum of 90 minutes.
2. To test, depress the “TEST” switch. The emergency lamps will illuminate. When the switch is released, the lamps will go off.

## **WIRING DIAGRAM**

